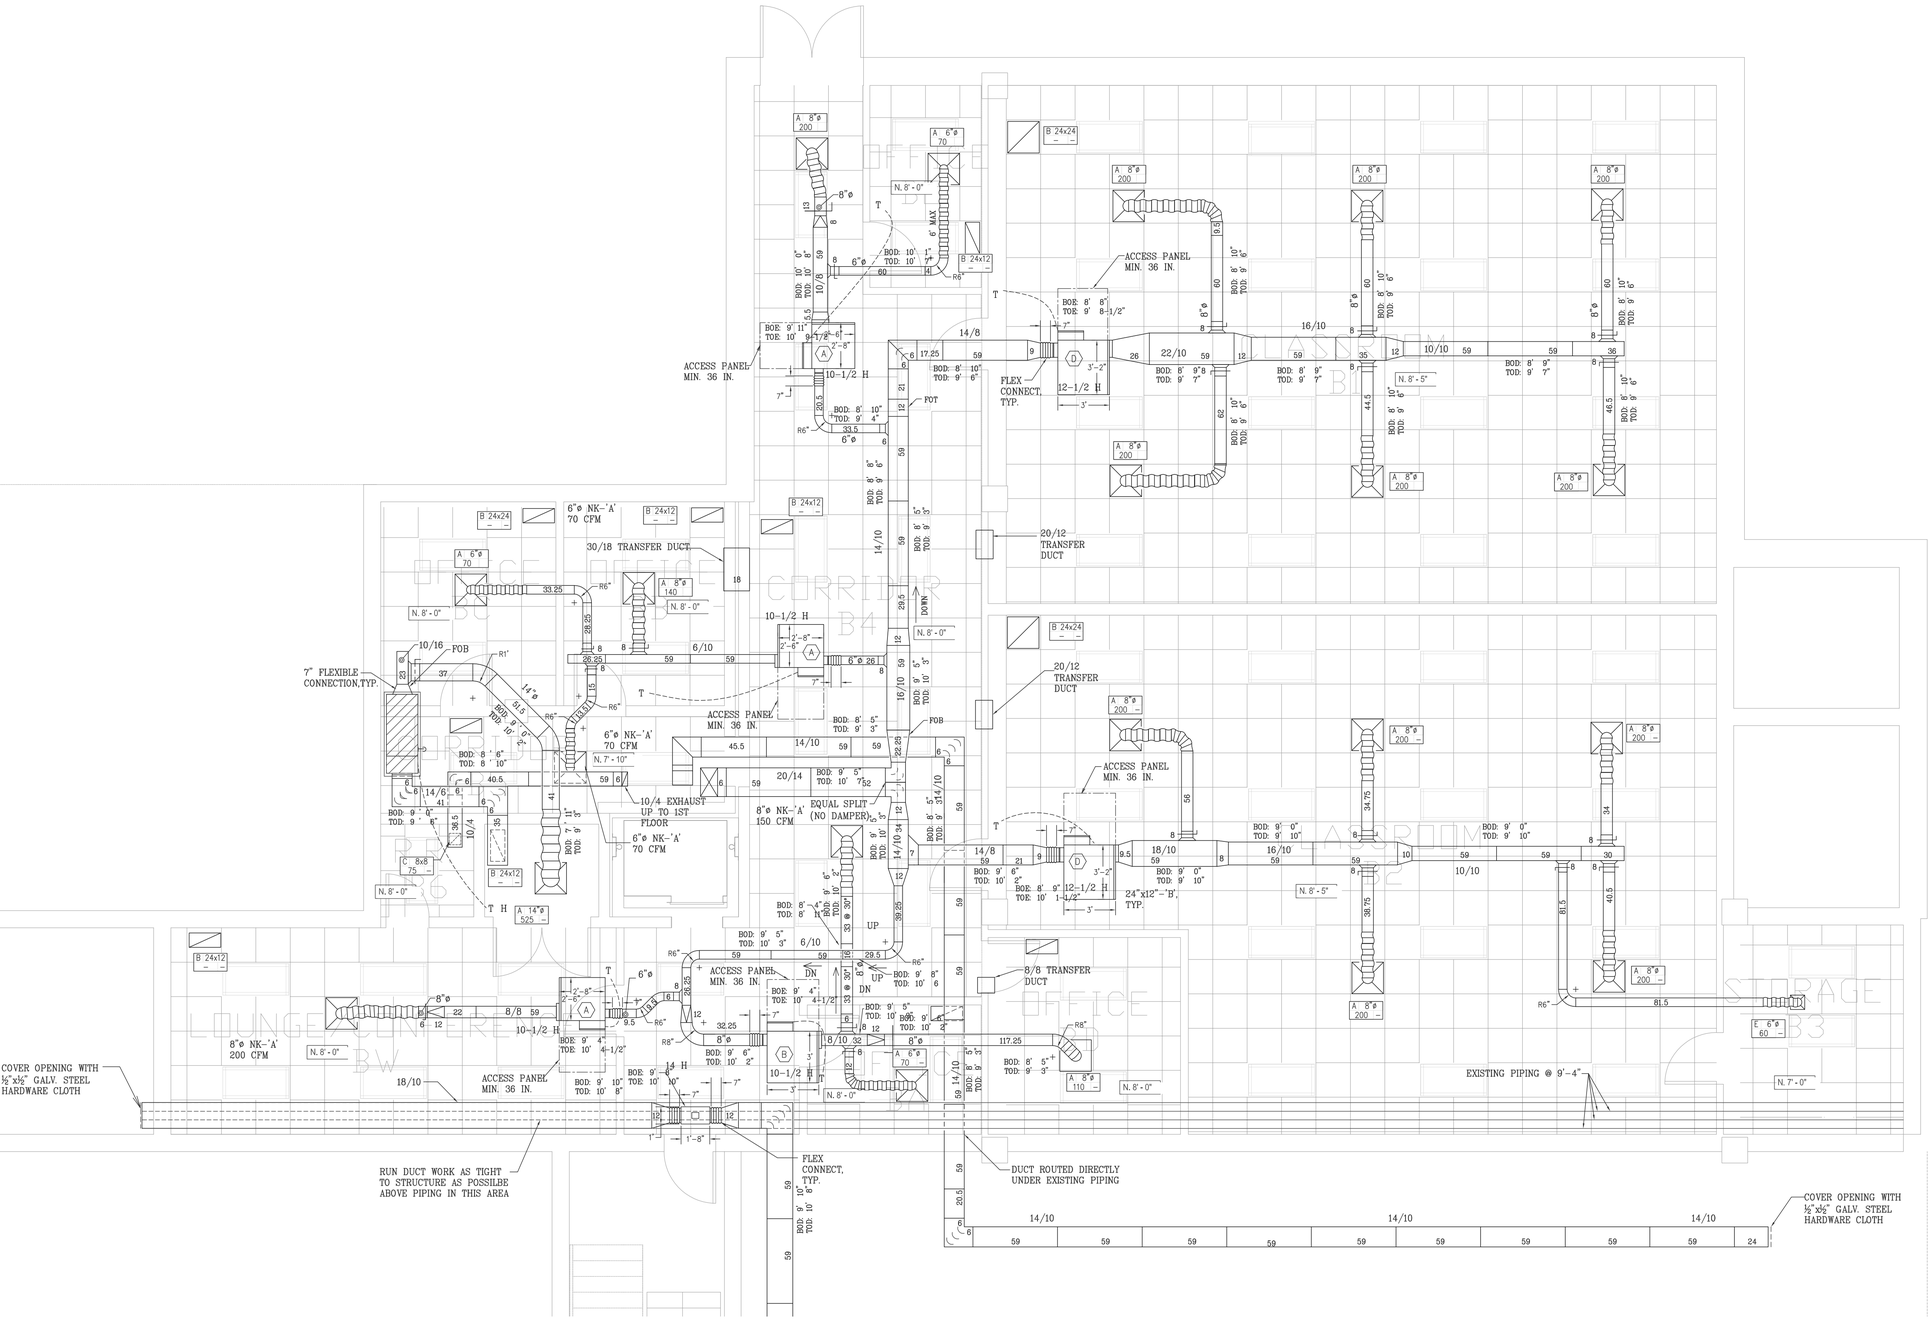

GENERAL NOTES:

1. COORDINATE ALL DUCTWORK WITH OTHER DISCIPLINES BEFORE INSTALLATION.
2. INSTALL DUCTWORK AS TIGHT AS POSSIBLE TO STRUCTURE.
3. ALL HVAC EQUIPMENT SHALL BE FROM SPECS LOCATED IN THE SUBMITTALS.
4. DUCT SIZES INDICATED ON CONTRACT DOCUMENTS ARE INSIDE FREE AREA DIMENSIONS. COORDINATE SHEET METAL SIZES ACCORDINGLY.
5. EXPOSED DUCT SHALL BE DOUBLE WALL SPIRAL WOUND.
6. DUCT ELEVATIONS ARE ABOVE FINISHED FLOOR.

NORTH

01 BASEMENT FLOOR - HVAC

SCALE: 1/4"=1'-0"